GENERAL NOTES:

A. FIXTURES ON CIRCUITS FROM PANEL EH4 ARE FED VIA THE GENERATOR THROUGH A TRANSFER SWITCH. ANY AUTOMATIC CONTROLS SHALL DEFAULT TO THE ON POSITION AFTER POWER CYCLE.
B. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN AND DETAILS FOR THE LOCATION OF ALL LIGHTING FIXTURES AND ALL OTHER EQUIPMENT INSTALLED IN THE CEILING SYSTEM. VERIFY MOUNTING HEIGHTS AND FINISHES WITH ARCHITECT PRIOR TO ROUGH-IN.
C. CONFIRM ALL FIXTURE TYPES WITH INTERIOR DESIGNER PRIOR TO PURCHASE OR ROUGH-IN.
D. ELECTRICAL CONTRACTOR IS TO PROVIDE ALL LIGHT FIXTURES. SEE FIXTURE SCHEDULE ON SHEET E009.
E. THE NUMBER OF WIRES PER CONDUIT ARE NOT INDICATED ON THE LIGHTING PLAN(S). DO NOT EXCEED CONDUIT FILL CAPACITY WITHOUT DERATING WIRING AMPACITY BASED ON NEC AMPACITY TABLE 310.15(B)(3)(a). PROVIDE DEDICATED NEUTRALS TO FIXTURES INTENDED TO BE DIMMED.
F. MOUNT EXIT SIGNS 12" ABOVE DOOR OR ON CEILING, UNLESS OTHERWISE NOTED. ARRANGE DIRECTIONAL ARROWS TO INDICATE DIRECTION OF EXIT, AS REQUIRED.
G. FIRE ALARM DEVICES ARE SHOWN FOR INTENT PURPOSES ONLY. CONTRACTOR SHALL PROVIDE A COMPLETE FIRE ALARM SYSTEM, COMPLYING WITH LOCAL CODES / NFPA AND PROVIDE STAMPED DRAWINGS BY A LICENSES FIRE ENGINEER SHOWING DEVICE LOCATIONS AND ALL CALCULATIONS.

KEY NOTES:

1. ALL AREAS ABOVE CEILING ARE RETURN PLENUMS. ALL ELECTRICAL EQUIPMENT, BRANCH CIRCUITS, LOW VOLTAGE, ETC. SHALL BE PLENUM RATED ABOVE THE CEILING.

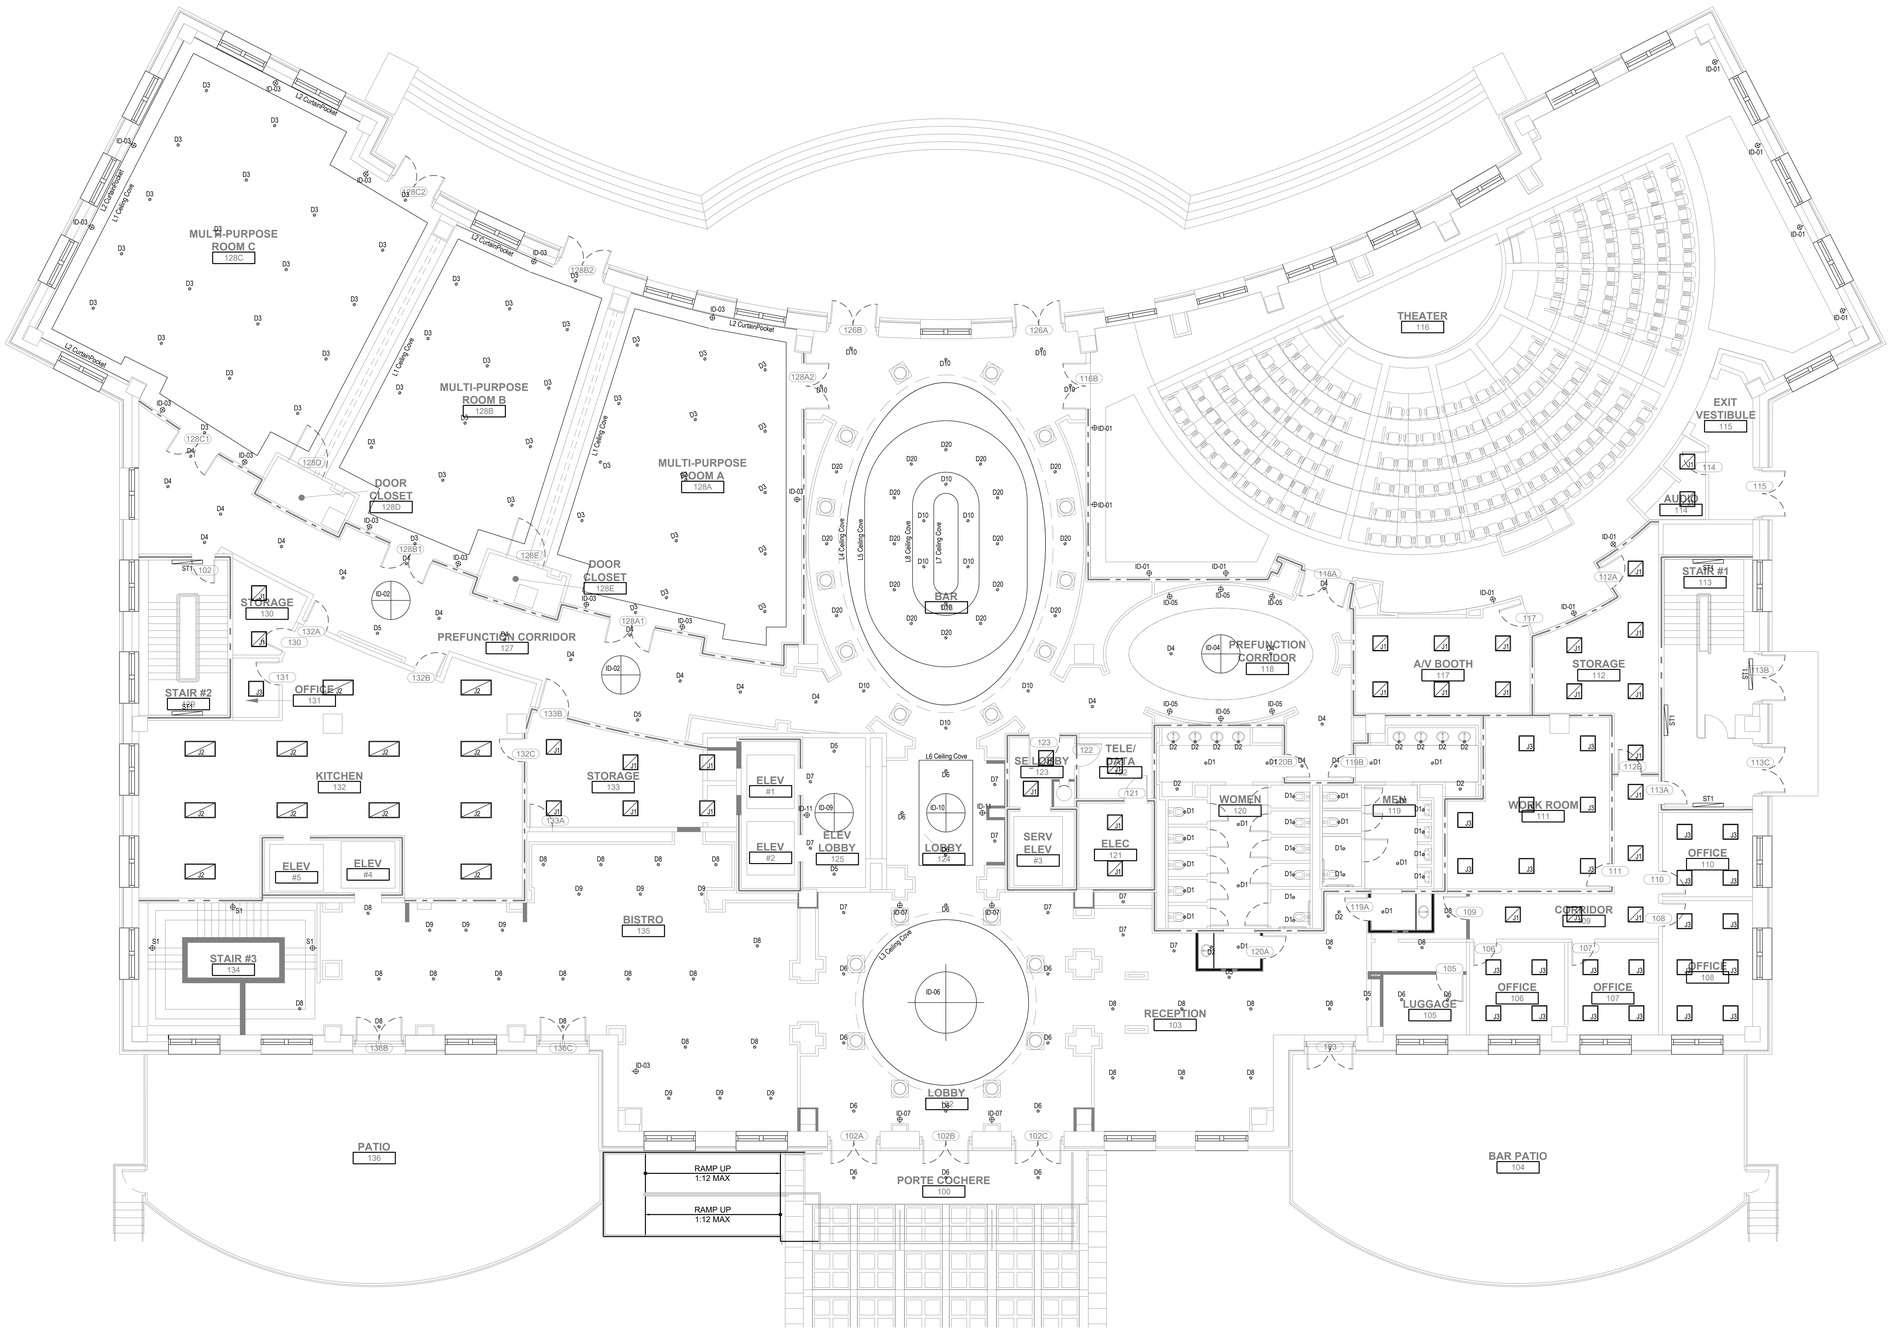

1 ELECTRICAL OVERALL CEILING PLAN - LEVEL 1
SCALE: 1/8" = 1'-0"

STIPULATION FOR REUSE:
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT DULUTH, GA CONTEMPORANEOUSLY WITH ITS ISSUE DATE AS NOTED BELOW, AND IT IS NOT SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.

CONSULTANTS:
Beach Engineering Solutions Team
Mechanical, Electrical & Plumbing Engineering
(678) 665-3280
Project Number: 23-547

THE STRICKLANDER
MARRIOTT AUTOGRAPH
PUBLIC SPACE
6405 SUGARLOAF PARKWAY
DULUTH, GEORGIA 30097

INTERIM REVIEW
NOT FOR REGULATORY APPROVAL, PERMITTING OR CONSTRUCTION

ISSUE BLOCK:

DOCUMENT DATE:	04/02/2026
DRAWN BY:	
CHECKED BY:	
PROJECT NO.:	JHD-024-NA-100002

SHEET TITLE:
ELECTRICAL OVERALL CEILING PLAN - LEVEL 1

SHEET NUMBER:
E-101