

GENERAL NOTES:

- A. ALL 15A/20A RECEPTACLES IN KITCHENS, FOOD PREP AREAS, RESTROOMS, OR ON EXTERIOR SHALL BE GFCI TYPE. GFCI RECEPTACLES SHALL BE INSTALLED IN ACCORDANCE WITH 2009 NEC ARTICLE 210.8 AND BE READILY ACCESSIBLE. FOR EQUIPMENT THAT WOULD HAVE TO BE MOVED TO RESET THE RECEPTACLE PER THE NEC DEFINITION, A GFCI BREAKER SHALL BE UTILIZED IN LIEU OF A RECEPTACLE.
- B. COORDINATE WITH OWNER/ARCHITECT ON DEVICE PLATE COLOR THROUGHOUT SUITE PRIOR TO PURCHASE OR INSTALLATION. CONFIRM ALL MOUNTING HEIGHTS AND LOCATIONS.
- C. SEE FIRE ALARM GENERAL NOTES ON SHEET E001 FOR FURTHER REQUIREMENTS. INTEGRATE NEW DEVICES SHOWN INTO FIRE ALARM SYSTEM. UPGRADE OR REPLACE EXISTING SYSTEM AS REQUIRED.
- D. SEE TAMPERPROOF RECEPTACLE NOTES ON SHEET E001 AND PROVIDE AS REQUIRED BY CODE. TAMPERPROOF RECEPTACLES ARE NOT NOTED ON THE FLOOR PLANS.
- E. SEE ENLARGED ROOM PLANS ON E301/302 SHEETS FOR EACH TYPICAL GUEST ROOM LAYOUT.

KEY NOTES:

- 1. COORDINATE LOCATION OF BRANCH CONTROLLERS WITH MECHANICAL CONTRACTOR. CIRCUIT TOGETHER (1) PER FLOOR. PROVIDE FUSED DISCONNECT AS SHOWN.
- 2. OUTDOOR UNIT POWERS THE INDOOR UNIT. PROVIDE 208V/20A CIRCUIT BETWEEN UNITS IN CONDUIT AND A DISCONNECT AT BOTH THE INDOOR UNIT AND THE OUTDOOR UNIT.

STIPULATION FOR REUSE:
THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT DULUTH, GA CONTEMPORANEOUSLY WITH ITS ISSUE DATE AS NOTED BELOW. AND IT IS NOT SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.



CONSULTANTS:
bes
Beach Engineering Solutions Team
Mechanical, Electrical & Plumbing Engineering
(678) 665-3280
Project Number: 23-547

THE STRICKLANDER
MARRIOTT AUTOGRAPH
GUESTROOMS
6405 SUGARLOAF PARKWAY
DULUTH, GEORGIA 30097




ISSUE BLOCK:

△ CITY REVISIONS	11/22/24
△ REV #4	05/28/25
△ REV #5	04/02/26

DOCUMENT DATE:	10/25/24
DRAWN BY:	
CHECKED BY:	
PROJECT NO.:	JHD-024-NA-100001
SHEET TITLE:	

**ELECTRICAL
OVERALL FLOOR
PLAN - LEVEL 4**

SHEET NUMBER:
E-204

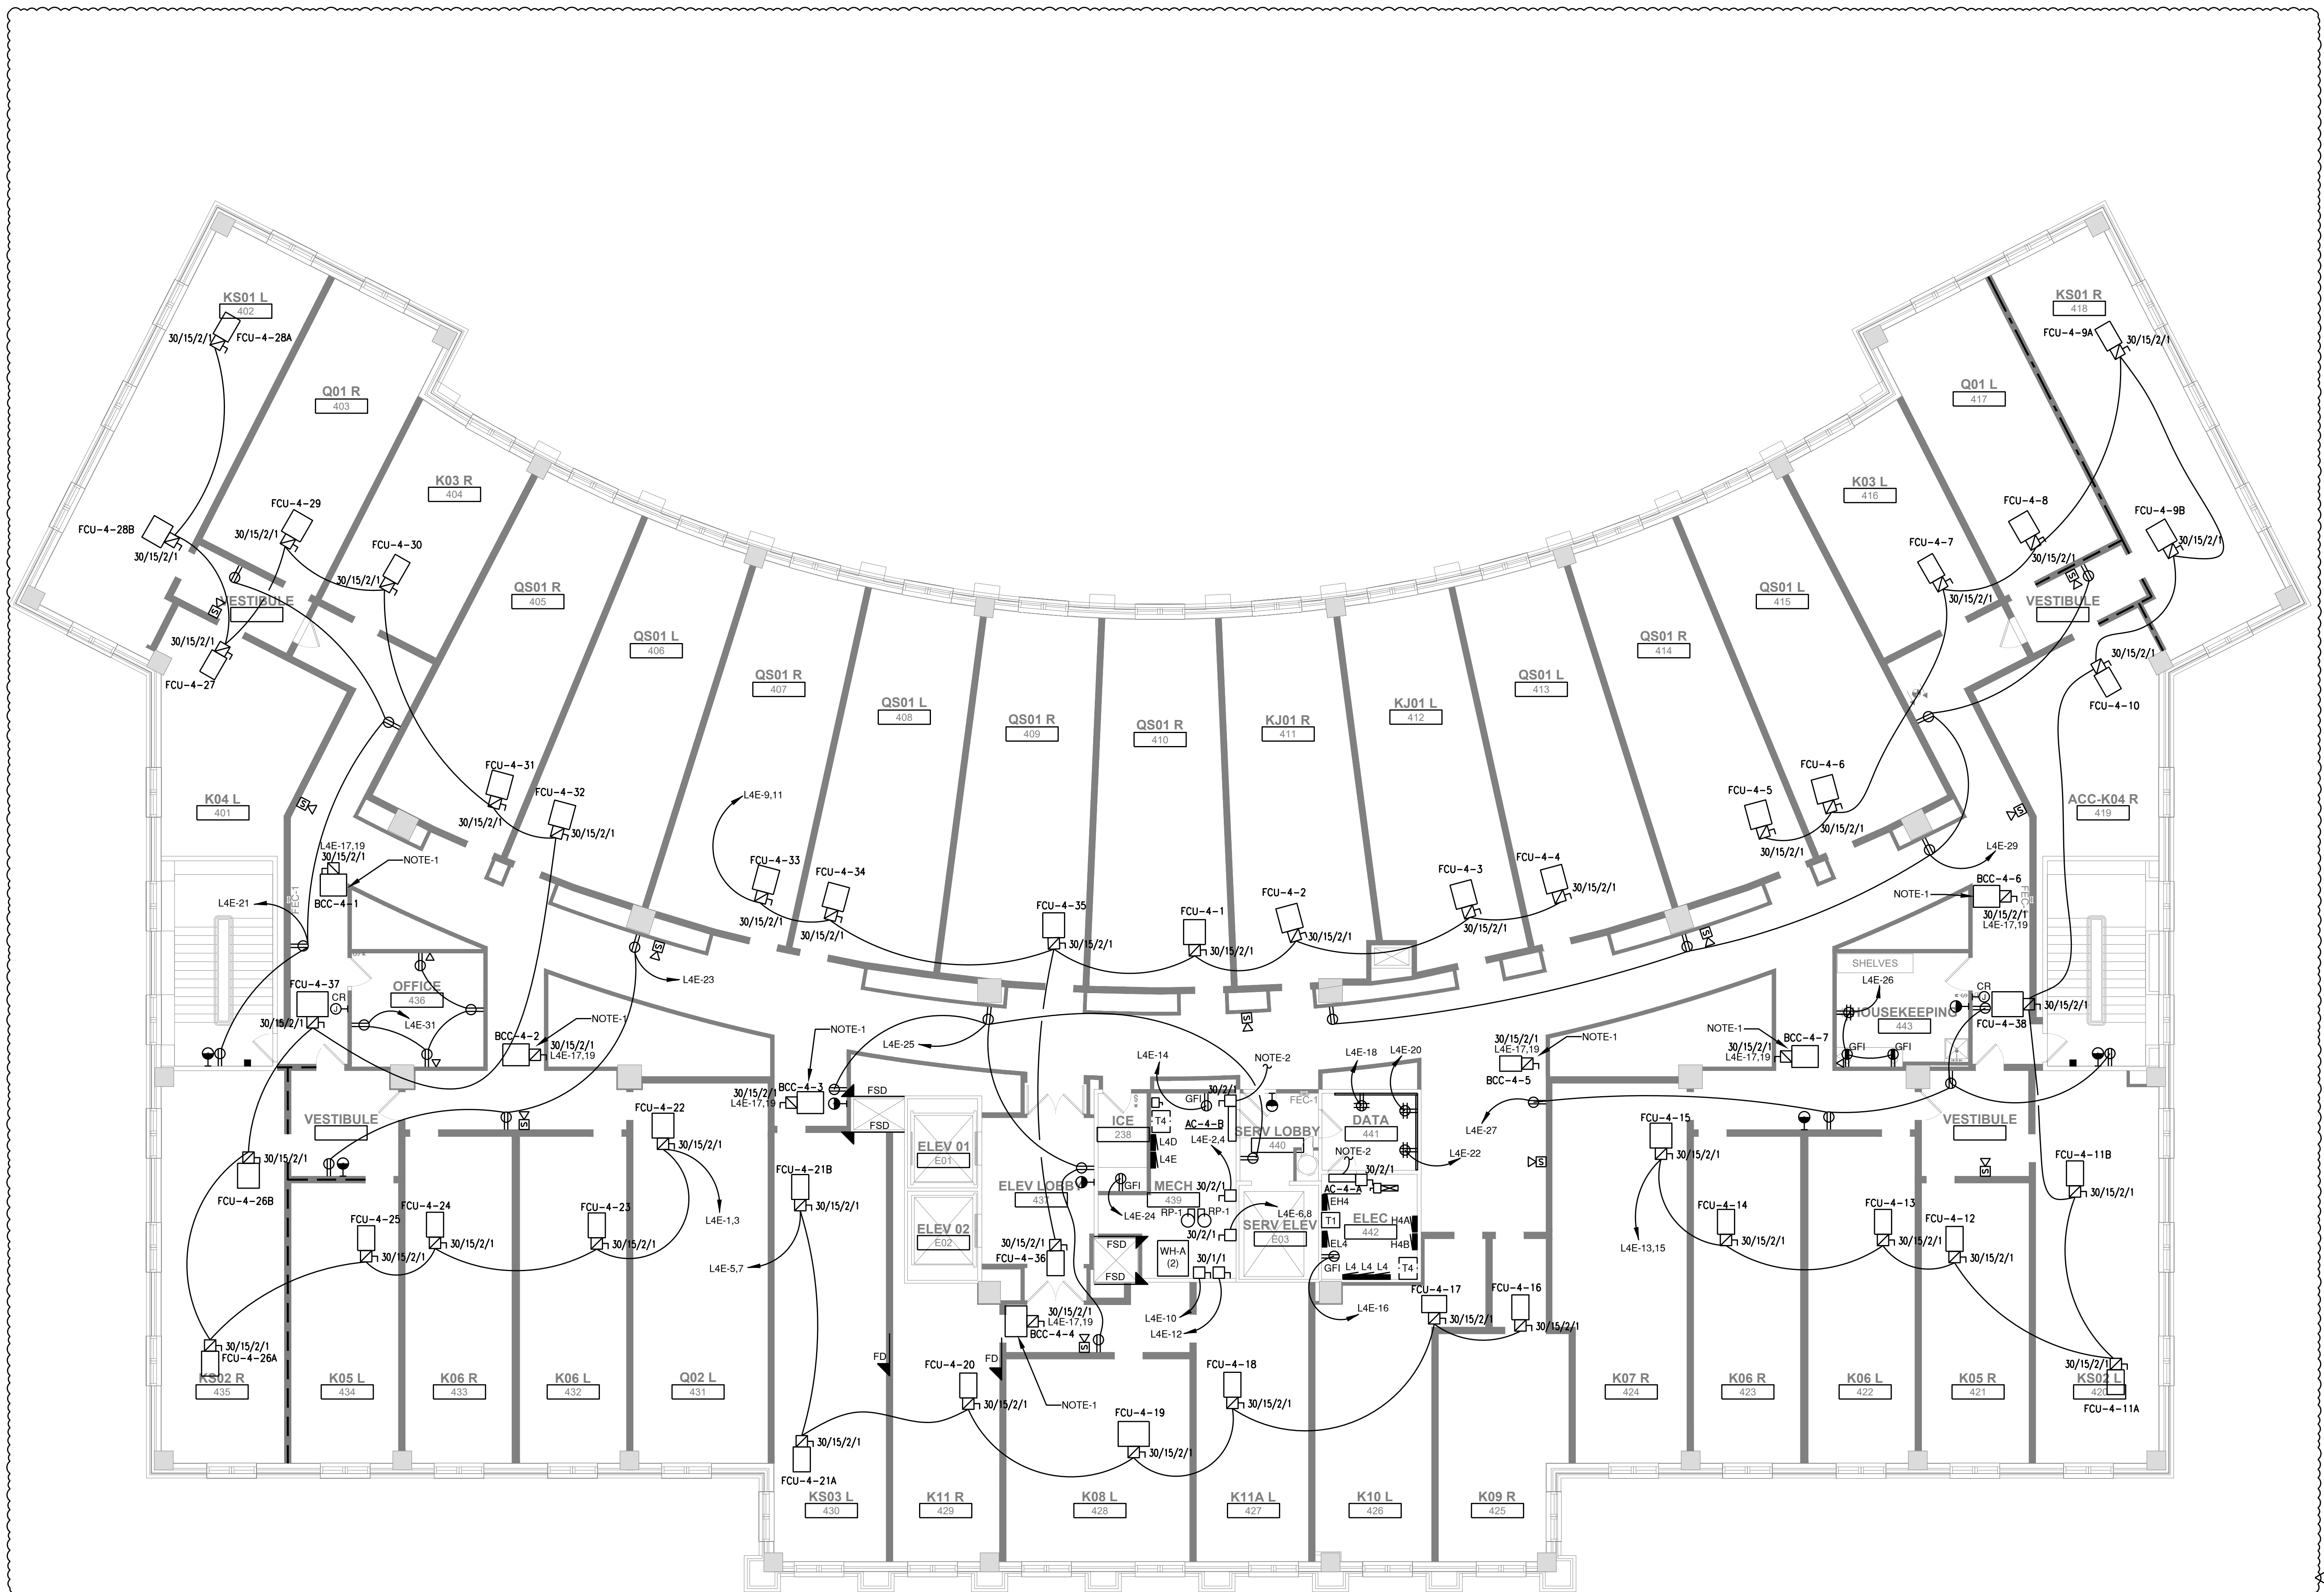

1 ELECTRICAL OVERALL FLOOR PLAN - LEVEL 4
SCALE: 1/8" = 1'-0"