


STIPULATION FOR REUSE:
 THIS DRAWING WAS PREPARED FOR USE ON A SPECIFIC SITE AT DULUTH, GA CONTEMPORANEOUSLY WITH ITS ISSUE DATE AS NOTED BELOW, AND IT IS NOT SUITABLE FOR USE ON A DIFFERENT PROJECT SITE OR AT A LATER TIME. USE OF THIS DRAWING FOR REFERENCE OR EXAMPLE ON ANOTHER PROJECT REQUIRES THE SERVICES OF PROPERLY LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR REUSE ON ANOTHER PROJECT IS NOT AUTHORIZED AND MAY BE CONTRARY TO THE LAW.



CONSULTANTS:
Beach Engineering Solutions Team
 Mechanical, Electrical & Plumbing Engineering
 (678) 665-3280
 Project Number: 23-547

THE STRICKLANDER
MARRIOTT AUTOGRAPH
GUESTROOMS
 6405 SUGARLOAF PARKWAY
 DULUTH, GEORGIA 30097

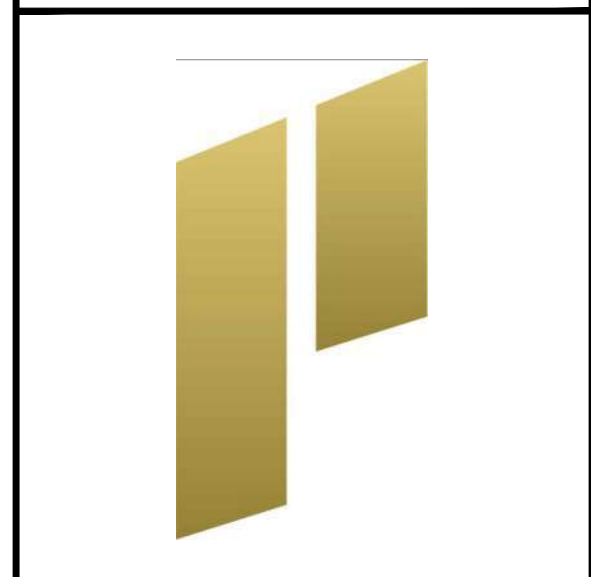

ISSUE BLOCK:


1	REV 1	11.22.2024
2	REV 2	04.07.2025
3	REV 3	04.18.2025
4	REV 4	05.28.2025
5	REV 5	04.02.2026

DOCUMENT DATE:	04/02/26
DRAWN BY:	CL/YC
CHECKED BY:	BGB
PROJECT NO.:	JHD-024-NA-100001
SHEET TITLE:	

DOCUMENT DATE:	04/02/26
DRAWN BY:	CL/YC
CHECKED BY:	BGB
PROJECT NO.:	JHD-024-NA-100001
SHEET TITLE:	

HVAC
DEMOLITION
PLAN - ROOF

SHEET NUMBER:
M-107

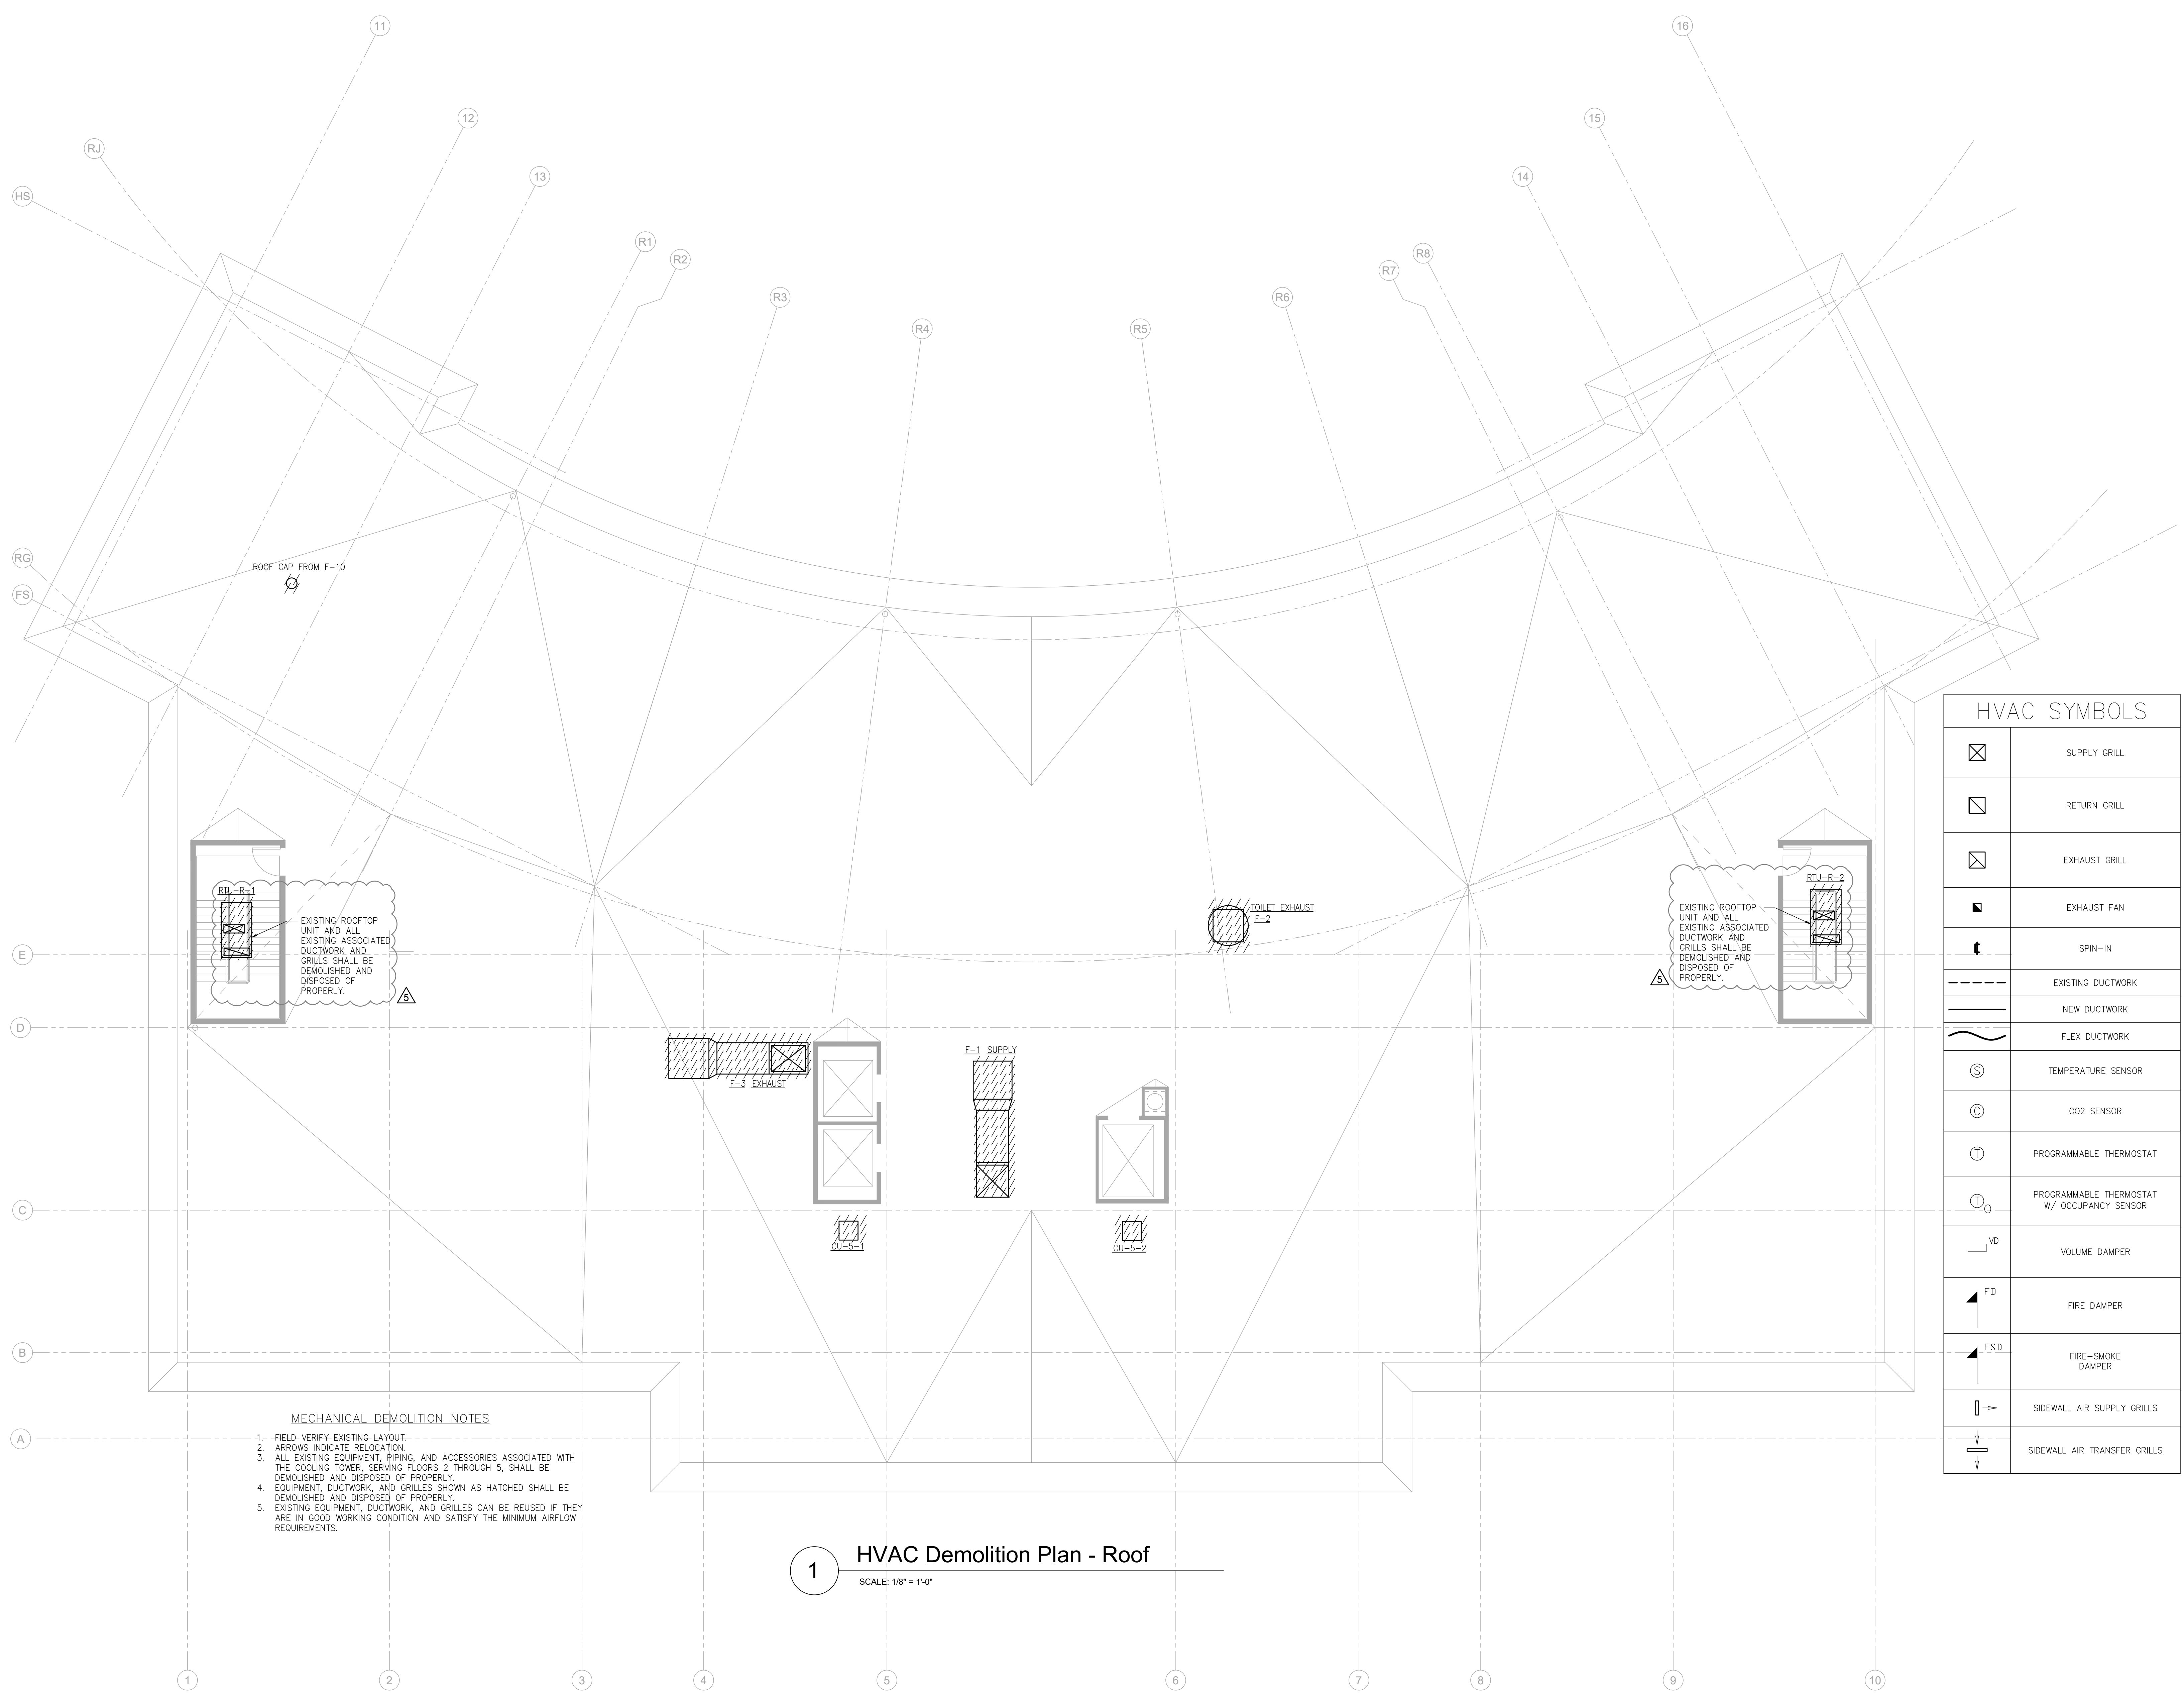

HVAC SYMBOLS

☒	SUPPLY GRILL
☐	RETURN GRILL
☒	EXHAUST GRILL
■	EXHAUST FAN
t	SPIN-IN
---	EXISTING DUCTWORK
---	NEW DUCTWORK
~	FLEX DUCTWORK
⊙	TEMPERATURE SENSOR
⊙	CO2 SENSOR
⊙	PROGRAMMABLE THERMOSTAT
⊙	PROGRAMMABLE THERMOSTAT W/ OCCUPANCY SENSOR
∟	VOLUME DAMPER
▲	FIRE DAMPER
▲	FIRE-SMOKE DAMPER
∟	SIDEWALL AIR SUPPLY GRILLS
∟	SIDEWALL AIR TRANSFER GRILLS

- MECHANICAL DEMOLITION NOTES**
1. FIELD VERIFY EXISTING LAYOUT.
 2. ARROWS INDICATE RELOCATION.
 3. ALL EXISTING EQUIPMENT, PIPING, AND ACCESSORIES ASSOCIATED WITH THE COOLING TOWER, SERVING FLOORS 2 THROUGH 5, SHALL BE DEMOLISHED AND DISPOSED OF PROPERLY.
 4. EQUIPMENT, DUCTWORK, AND GRILLES SHOWN AS HATCHED SHALL BE DEMOLISHED AND DISPOSED OF PROPERLY.
 5. EXISTING EQUIPMENT, DUCTWORK, AND GRILLES CAN BE REUSED IF THEY ARE IN GOOD WORKING CONDITION AND SATISFY THE MINIMUM AIRFLOW REQUIREMENTS.

1 HVAC Demolition Plan - Roof
 SCALE: 1/8" = 1'-0"